


Inductive positioning system


PMI210-F110-IU-V1



- Analog output 0 V ... 10 V/4 mA ... 20 mA
- Measuring range 0 ... 210 mm

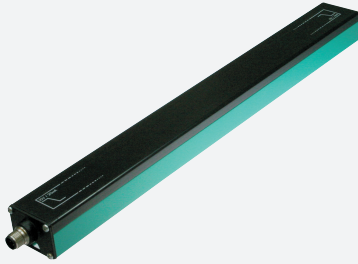

Dimensions

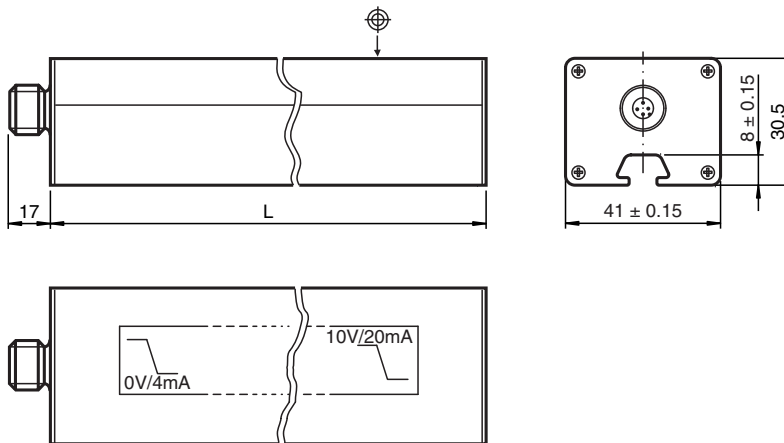

Technical Data

General specifications

| | |
|----------------------------|-----------------------------------|
| Switching element function | analog, current or voltage output |
| Object distance | max. 6 mm |
| Measurement range | 0 ... 210 mm |


Nominal ratings

| | | |
|-----------------------------|-------|---------------------------------|
| Operating voltage | U_B | 18 ... 30 V DC |
| Reverse polarity protection | | reverse polarity protected |
| Linearity error | | ± 0.4 mm |
| Repeat accuracy | R | ± 0.2 mm |
| Resolution | | 210 μ m |
| Temperature drift | | ± 0.5 mm (-25 °C ... 70 °C) |
| No-load supply current | I_0 | ≤ 40 mA |
| Operating voltage indicator | | LED green |


Technical Data

| | | |
|------------------------------------------|--|----------------------------------------------------------------------------------------------------|
| Functional safety related parameters | | |
| MTTF _d | | 337 a |
| Mission Time (T _M) | | 20 a |
| Diagnostic Coverage (DC) | | 0 % |
| Analog output | | |
| Output type | | 1 current output: 4 ... 20 mA 1 voltage output: 0 ... 10 V |
| Load resistor | | current output: ≤ 400 Ω voltage output: ≥ 1000 Ω |
| Short-circuit protection | | voltage output: pulsing |
| Compliance with standards and directives | | |
| Standard conformity | | |
| Standards | | EN 60947-5-2:2007 EN 60947-5-2/A1:2012 IEC 60947-5-2:2007 IEC 60947-5-2 AMD 1:2012 |
| Approvals and certificates | | |
| UL approval | | cULus Listed, General Purpose, Class 2 Power Source |
| CCC approval | | CCC approval / marking not required for products rated ≤36 V |
| Ambient conditions | | |
| Ambient temperature | | -25 ... 70 °C (-13 ... 158 °F) |
| Mechanical specifications | | |
| Connection type | | 4-pin, M12 x 1 connector |
| Housing length L | | 250 mm |
| Degree of protection | | IP65 |
| Material | | |
| Housing | | PA 6 / AL |
| Target | | mild steel, e. g. 1.0037, SR235JR (formerly St37-2) |
| Note | | The data relating to accuracy only apply to a distance to the object to be detected of 1 ... 6 mm. |

Connection



Connection Assignment







Release date: 2020-04-27 Date of issue: 2020-04-27 Filename: 191142_eng.pdf

Wire colors in accordance with EN 60947-5-2

| | | |
|---|----|---------|
| 1 | BN | (brown) |
| 2 | WH | (white) |
| 3 | BU | (blue) |
| 4 | BK | (black) |

Accessories

| | | |
|-----------------------------------------------------------------------------------|--------------------|---------------------------------------------------------------|
|  | BT-F110-G | Damping element for F110 housing sensors; front screw holes |
|  | BT-F110-W | Damping element for F110 housing sensors; lateral screw holes |
|  | V1-G-2M-PVC | Female cordset, M12, 4-pin, PVC cable |
|  | MH-F110 | Mounting bracket for mounting F110 series sensors |

Installation

Instruction manual

- Security advice



This product must not be used in applications, where safety of persons depend on the correct device function.
This product is not a safety device according to EC machinery directive.

- Sensor Properties

The inductive positioning system F110 provides both, a current and voltage signal at the outputs, which is proportional to the position of the attenuating element.
Output signals: 4 mA ... 20 mA and 0 V ... 10 V

- Attenuating element

The inductive position encoding system F110 is optimally adjusted to the geometry of the attenuating elements we offer (see accessories, below).



When using your own attenuating elements, you must ensure that the active surface of the attenuating element has a width of exactly 13 mm and overlaps the entire sensor width (41 mm).

A different width has a direct impact on the achievable resolution and accuracy of the system.


Spacing between sensor and attenuating element is from 0 ... 6 mm.

Sensing accuracy is guaranteed between 1 ... 6 mm..



- Installation and operation

Notes on installation

- A flush installation is possible.
- Fixation and installation of the positioning system F110 is carried out by the use of t-slides. This provides a flexible adaptation to the field situation.

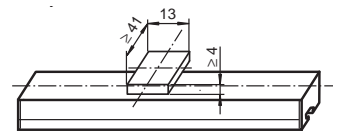

- The distance between the measuring field (bordered area at the front of the sensor) and the fixing base or fixing element of the attenuating element must at least be 6 mm.

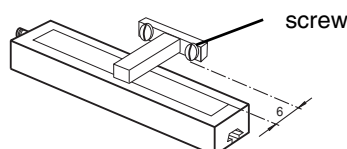
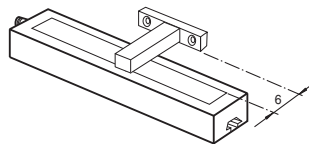


- Notes on operation

The sensor accuracy can be guaranteed, when the spacing between attenuating element and sensor is within an interval of 1 ... 6 mm.


When the attenuating element leaves the measurement range (figures below):

- the last valid value is maintained at the voltage output until the attenuating element re-enters the valid range.
- the last valid value is maintained at the current output for 0.5 seconds. Afterwards, the output changes to a fault current of 3.6 mA until the attenuating element re-enters the valid range.

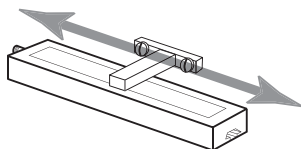


- Definition of measuring range / of measured position

The measured attenuating elements (actuators) position refers to half its width (middle of the actuator). The measuring range starts and ends when the attenuating element overlaps the labeled measuring area on the sensor at transversal motion (see



left figure above).

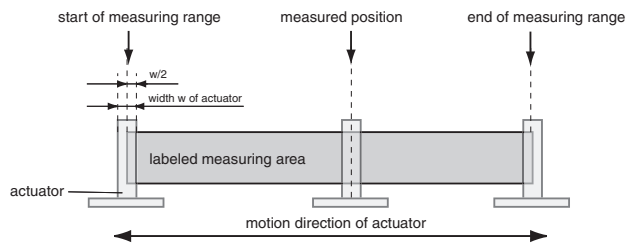

- Accessories

Attenuating elements

BT-F110-G



BT-F110-W



Mounting brackets

MH-F110



Straight cables:V1-G-2M-PVC (4 wire)

Angled cables:V1-W-2M-PVC (4 wire)