

OCP162H0180

LASER


Part Number



- High resolution: 20 μm (resolution-mode)
- Linearity: 0,1 % (resolution-mode)
- Measured value independent of material, color and brightness
- Zoom function

These sensors work with a high-resolution CMOS line and DSP technology and determine distance using angular measurement. As a result, material, color and brightness related measurement differences are virtually eliminated.

Integrated analogue output can be configured for voltage 0...10 V (10...0 V) or current 4...20 mA (20...4 mA).

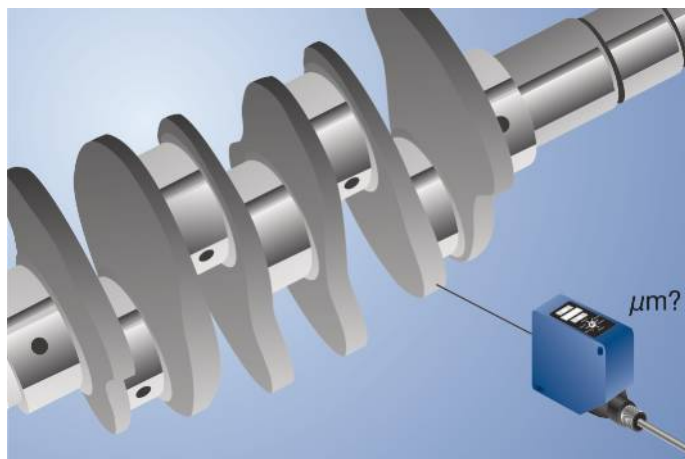


Technical Data


Optical Data	
Working Range	40...160 mm
Measuring Range	120 mm
Resolution	20 μm
Resolution (Speed-Mode)	30 μm
Linearity	0,1 %
Linearity (Speed-Mode)	0,2 %
Light Source	Laser (red)
Wavelength	660 nm
Service Life (T = +25 °C)	100000 h
Laser Class (EN 60825-1)	1
Max. Ambient Light	10000 Lux
Light Spot Diameter	see Table 1
Electrical Data	
Supply Voltage	18...30 V DC
Current Consumption (U _b = 24 V)	< 80 mA
Measuring Rate	1000 /s
Measuring Rate (Resolution-Mode)	500 /s
Response Time	< 1000 μs
Response Time (Resolution Mode)	< 2000 μs
Temperature Drift	< 10 $\mu\text{m/K}$
Temperature Range	-25...50 °C
Analog Output	0...10 V/4...20 mA
Load Current Voltage Output	< 1 mA
Current Output Load Resistance	< 500 Ohm
Interface	RS-232
Baud Rate	38400 Bd
Protection Class	III
FDA Accession Number	1120717-000
Mechanical Data	
Setting Method	Teach-In
Housing Material	Plastic
Degree of Protection	IP67
Connection	M12 × 1; 8-pin
Safety-relevant Data	
MTTFd (EN ISO 13849-1)	713,97 a
Error Output	●
Analog Output	●
RS-232 Interface	●
Connection Diagram No.	529
Control Panel No.	P7
Suitable Connection Equipment No.	80
Suitable Mounting Technology No.	380

Complementary Products


Analog Evaluation Unit AW02
Fieldbus Gateway ZAGxxxN01, EPGG001
Interface Cable S232W3
Protective Housing ZSV-0x-01
Set Protective Housing ZSP-NN-02
Software

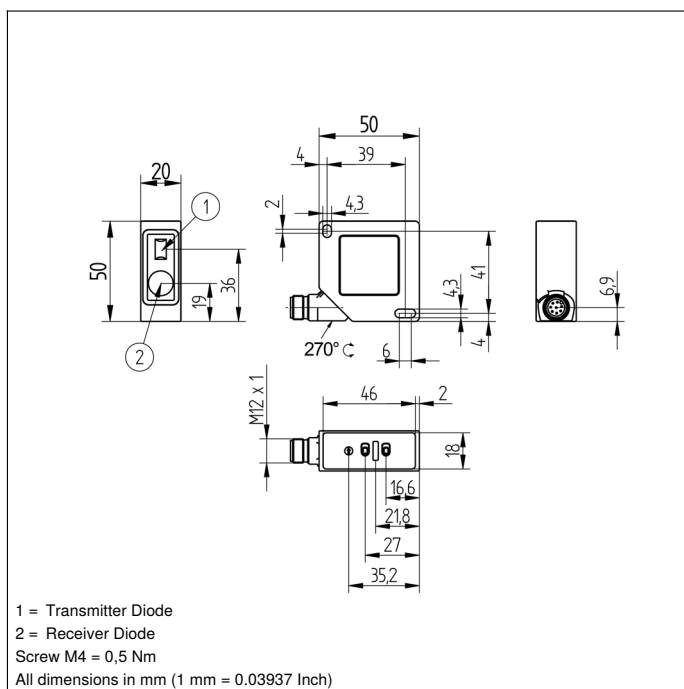

Ctrl. Panel

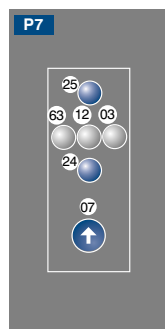

- 03 = Error Indicator
07 = Selector Switch
12 = Analog Output Indicator
24 = Plus Button
25 = Minus Button
63 = Analog Output Current Indicator

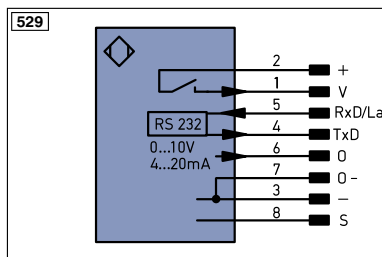

Legend


+	Supply Voltage +	PT	Platinum measuring resistor
-	Supply Voltage 0 V	nc	not connected
~	Supply Voltage (AC Voltage)	U	Test Input
A	Switching Output (NO)	U	Test Input inverted
Ä	Switching Output (NC)	W	Trigger Input
V	Contamination/Error Output (NO)	W-	Ground for the Trigger Input
V	Contamination/Error Output (NC)	O	Analog Output
E	Input (analog or digital)	O-	Ground for the Analog Output
T	Teach Input	BZ	Block Discharge
Z	Time Delay (activation)	Awv	Valve Output
S	Shielding	a	Valve Control Output +
RxD	Interface Receive Path	b	Valve Control Output 0 V
TxD	Interface Send Path	SY	Synchronization
RDY	Ready	SY-	Ground for the Synchronization
GND	Ground	E+	Receiver-Line
CL	Clock	S+	Emitter-Line
E/A	Output/Input programmable	±	Grounding
IO-Link	IO-Link	SnR	Switching Distance Reduction
PoE	Power over Ethernet	Rx+/-	Ethernet Receive Path
IN	Safety Input	Tx+/-	Ethernet Send Path
OSSD	Safety Output	Bus	Interfaces-Bus A(+)/B(-)
Signal	Signal Output	La	Emitted Light disengageable
BI..D+/-	Ethernet Gigabit bidirect. data line (A-D)	Mag	Magnet activation
EN0 RS422	Encoder 0-pulse 0-0 (TTL)	RES	Input confirmation
		EDM	Contactur Monitoring

ENAR5422	Encoder A/Ä (TTL)
EN0 RS422	Encoder B/B (TTL)
ENa	Encoder A
ENb	Encoder B
AMIN	Digital output MIN
AMAX	Digital output MAX
AOK	Digital output OK
SY in	Synchronization In
SY OUT	Synchronization OUT
OLT	Brightness output
M	Maintenance
rsv	reserved
Wire Colors according to IEC 60757	
BK	Black
BN	Brown
RD	Red
OG	Orange
YE	Yellow
GN	Green
BU	Blue
VT	Violet
GY	Grey
WH	White
PK	Pink
GNYE	Green/Yellow

Table 1

Working Distance	40 mm	160 mm
Spot Size	0,4 × 0,9 mm	0,9 × 1,8 mm

Output Graph

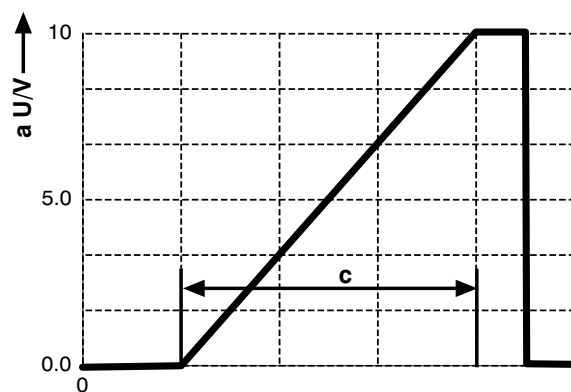

c = Measuring Range

a = Analog Voltage Output

