


ifm electronic




Operating instructions
Pressure sensor

efector500[®]

PN01xA

UK

706232 / 01 11 / 2013

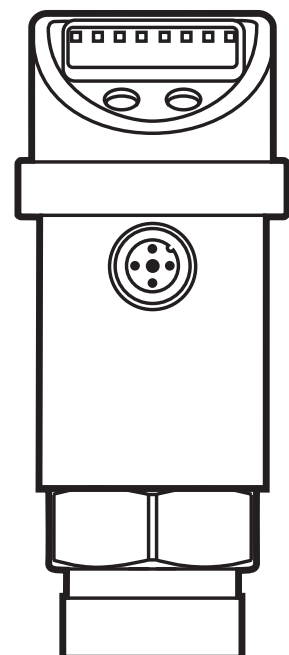

Contents

1 Preliminary note.....	3
1.1 Symbols used	3
2 Safety instructions	3
3 Functions and features	4
4 Function	4
4.1 Communication, parameter setting, evaluation	4
4.2 Switching function.....	5
4.3 Diagnostic function	5
5 Installation.....	6
6 Electrical connection.....	6
7 Operating and display elements	7
8 Menu.....	8
8.1 Menu structure.....	8
8.2 Explanation of the menu	9
9 Parameter setting	10
9.1 Parameter setting in general	10
9.2 Configure display (optional).....	12
9.3 Set output signals	12
9.3.1 Set the output function.....	12
9.3.2 Set switching limits	12
9.4 User settings (optional).....	13
9.4.1 Set delay for the switching outputs.....	13
9.4.2 Set output logic for the switching outputs	13
9.4.3 Set damping for the switching outputs.....	13
9.5 Service functions	13
9.5.1 Read min/max values for the system pressure	13
9.5.2 Reset all parameters to factory setting	13
10 Operation.....	14
10.1 Read set parameters	14
10.2 Error indications.....	14
10.3 Setting ranges	14

11 Scale drawing	15
12 Technical data	15
13 Factory setting	17

1 Preliminary note

1.1 Symbols used

- Instruction
- > Reaction, result
- [...] Designation of pushbuttons, buttons or indications
- Cross-reference

 Important note
Non-compliance can result in malfunction or interference.

 Information_Supplementary note.

UK

2 Safety instructions

- Please read the product description prior to set-up of the unit. Ensure that the product is suitable for your application without any restrictions.
- If the operating instructions or the technical data are not adhered to, personal injury and/or damage to property can occur.
- Check the compatibility of the product materials with the media to be measured in all applications. You can find information about the product materials in the technical data sheet (or → chapter 12 Technical data).
- Please adhere to the notes on safe use in hazardous areas: → Operating instructions (Ex protection related part) for pressure sensors according to the EU directive 94/9/EC annex VIII (ATEX) group II, equipment category 3D. If no operating instructions (Ex protection related part) or EC declaration of conformity is supplied with this product in the language of the EU user country, these can be requested from your dealer (see delivery note) or manufacturer (see cover sheet / back).

3 Functions and features

The unit monitors the system pressure of machines and installations.

Applications

Type of pressure: relative pressure

Order no.	Measuring range		Permissible overload pressure		Bursting pressure	
	bar	PSI	bar	PSI	bar	PSI
PN014A	-1...10	-14.5...145	75	1 087	150	2 175
PN016A	0.2...5	0.36...3	20	290	50	725

$$\text{MPa} = \text{bar} \div 10 / \text{kPa} = \text{bar} \times 100$$



Avoid static and dynamic overpressure exceeding the given overload pressure by taking appropriate measures.

The indicated bursting pressure must not be exceeded.

Even if the bursting pressure is exceeded only for a short time, the unit may be destroyed. NOTE: risk of injury!

4 Function

4.1 Communication, parameter setting, evaluation

- The unit displays the current process value.
- It generates 2 output signals according to the parameter setting.

OUT1	• Switching signal for process value; IO-Link.
OUT2	2 options • Switching signal for process value. • Diagnostic signal (output 2 is inactive in case of a fault).

- The following functions are available via IO-Link (OUT1): Reading the current process value, changing parameters and transferring them to other units of the same type using the FDT service program ifm Container or other parameter setting tools with IO-Link capability. The program library of the available DTM objects and the IO Device Description (IODD) are available at www.ifm.com → Service → Download.

4.2 Switching function


OUTx changes its switching state if it is above or below the set switching limits (SPx, rPx). The following switching functions can be selected:

- Hysteresis function / normally open: [OUx] = [Hno] (→ fig. 1).
- Hysteresis function / normally closed: [OUx] = [Hnc] (→ fig. 1).

First the set point (SPx) is set, then the reset point (rPx) with the requested difference.

- Window function / normally open: [OUx] = [Fno] (→ fig. 2).
- Window function / normally closed: [OUx] = [Fnc] (→ fig. 2).

The width of the window can be set by means of the difference between SPx and rPx. SPx = upper value, rPx = lower value.

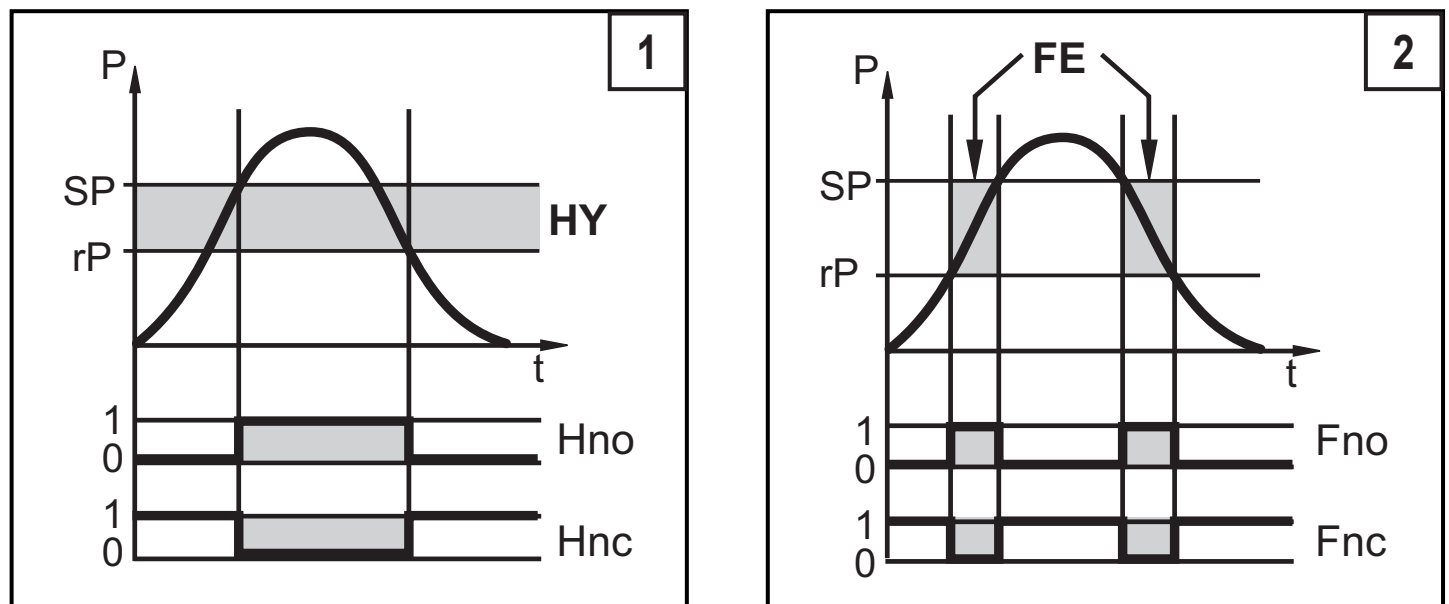

P = system pressure; HY = hysteresis; FE = window

4.3 Diagnostic function

Output 2 is used as diagnostic output based on the DESINA specification if [OU2] = [dESI].

- If there is no fault, the output is switched and carries UB+ (if P-n = PnP) or UB- (if P-n = nPn).
- In case of malfunctions the output becomes inactive. The following malfunctions are detected:
 - measuring cell defective;
 - short circuit in output 1

5 Installation



Before installing and removing the unit: Make sure that no pressure is applied to the system.


- ▶ Insert the unit in a G1/4 process connection.
- ▶ Tighten firmly.

6 Electrical connection



The unit must be connected by a qualified electrician.
The national and international regulations for the installation of electrical equipment must be adhered to.
Voltage supply to EN 50178, SELV, PELV.


- ▶ Disconnect power.
- ▶ Connect the unit as follows:

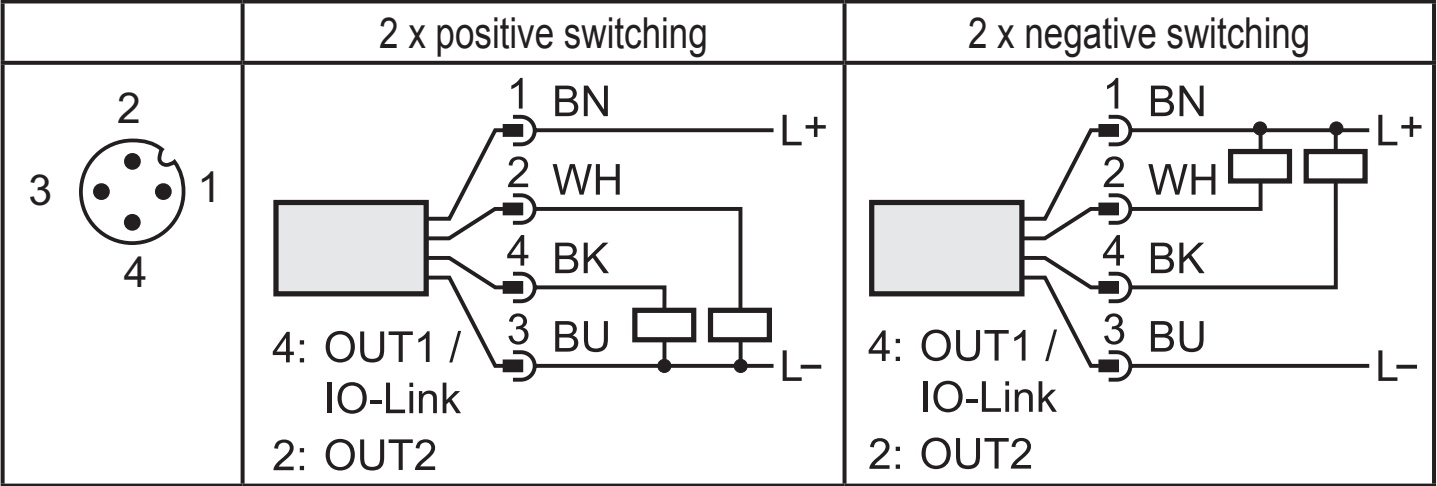

Pin 1	Ub+
Pin 3	Ub-
Pin 4 (OUT1)	• Binary switching output; IO-Link
Pin 2 (OUT2)	• Binary switching output if [OU2] = [Hno], [Hnc], [Fno] or [Fnc] • Diagnostic output if [OU2] = [dESI]

Core colours of ifm sockets:
1 = BN (brown), 2 = WH (white), 3 = BU (blue), 4 = BK (black)

7 Operating and display elements

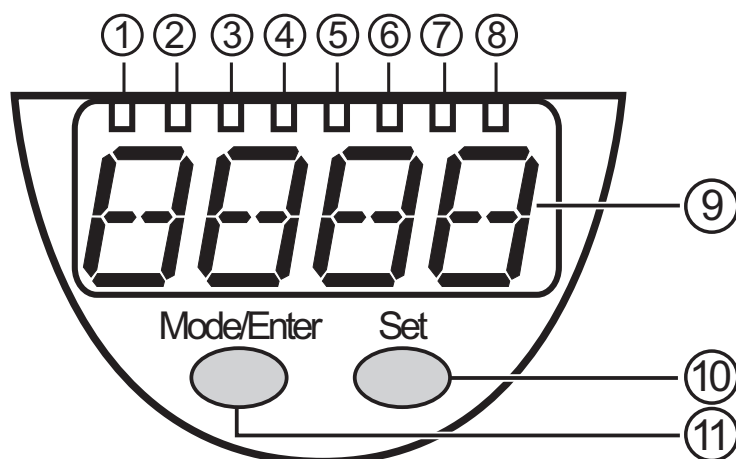

1 to 8: indicator LEDs

- LED 1 to LED 3 = system pressure in the unit of measurement which is indicated on the label.
- LEDs 4 - 6 not used.
- LED 7, LED 8 = switching state of the corresponding output.

9: Alphanumeric display, 4 digits

- Display of the current system pressure.
- Indication of the parameters and parameter values.

10: Set button


- Setting of the parameter values (scrolling by holding pressed; incrementally by pressing once).

11: Mode/Enter button

- Selection of the parameters and acknowledgement of the parameter values.

8 Menu

8.1 Menu structure

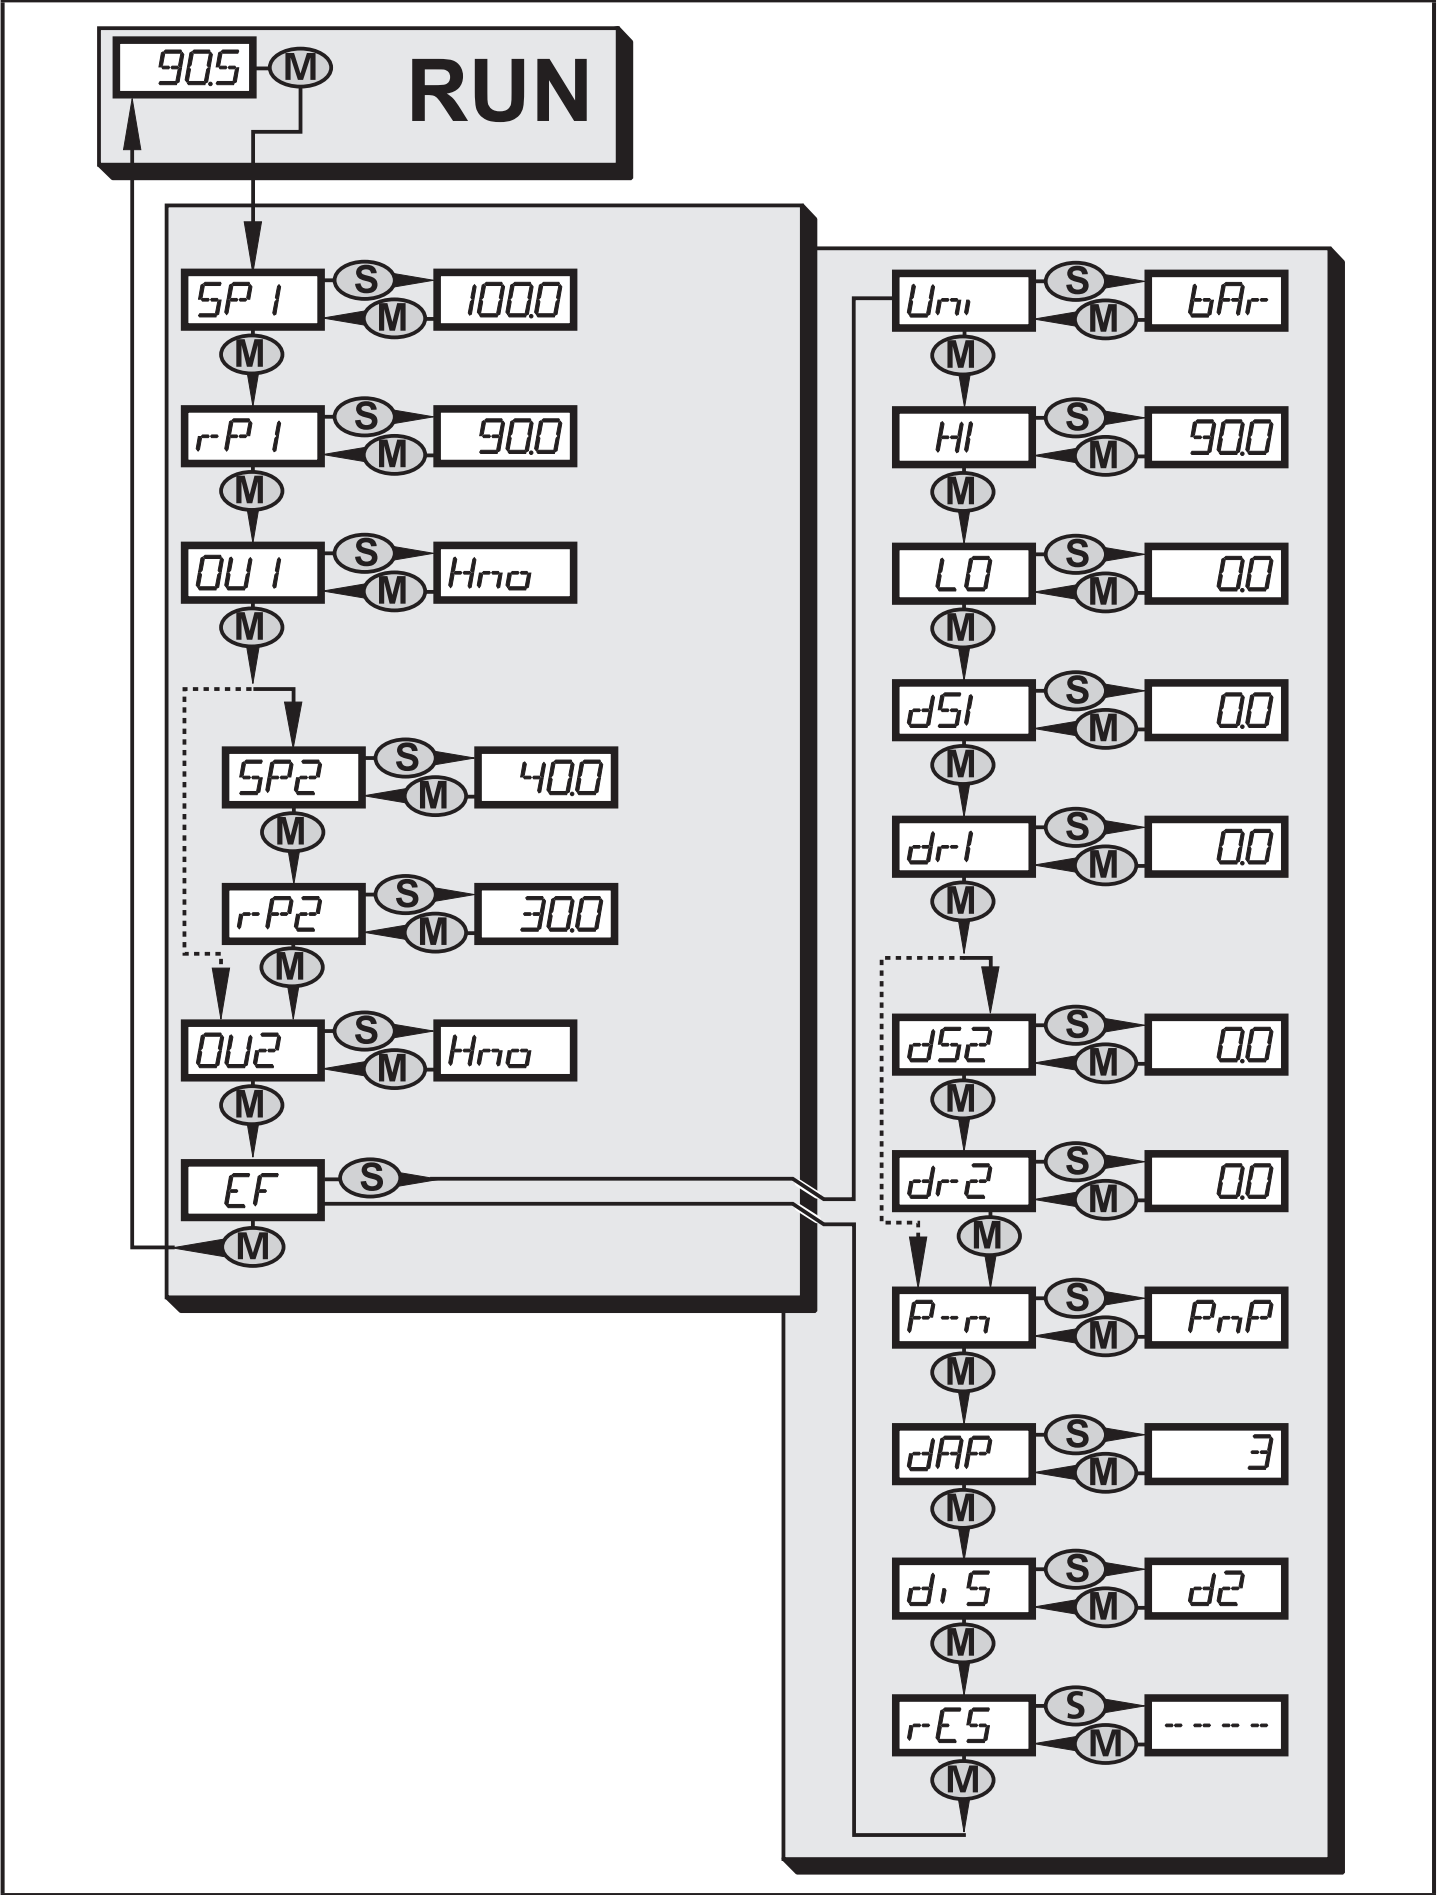

8.2 Explanation of the menu

SP1/rP1	Upper / lower limit value for system pressure at which OUT1 switches.
SP2/rP2	Upper / lower limit value for system pressure at which OUT2 switches.
OU1	Output function for OUT1: Switching signal for the pressure limit values: hysteresis function [H ..] or window function [F ..], either normally open [. no] or normally closed [. nc].
OU2	Output function for OUT2: - Switching signal for the pressure limit values: hysteresis function [H ..] or window function [F ..], either normally open [. no] or normally closed [. nc]. - Diagnostic signal [OU2] = dESI
EF	Extended functions / opening of menu level 2.
Uni	Standard unit of measurement for system pressure.
HI	Maximum value memory for system pressure.
LO	Minimum value memory for system pressure (only PN014A).
dS1/dS2	Switch-on delay for OUT1 / OUT2.
dr1/dr2	Switch-off delay for OUT1 / OUT2.
P-n	Output logic: pnp / npn.
dAP	Damping for the switching outputs.
diS	Update rate and orientation of the display.
rES	Restore factory setting.



UK

9 Parameter setting

During parameter setting the unit remains in the operating mode. It continues its monitoring functions with the existing parameters until the parameter setting has been completed.



9.1 Parameter setting in general

3 steps must be taken for each parameter setting:

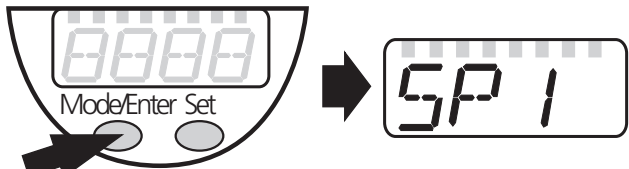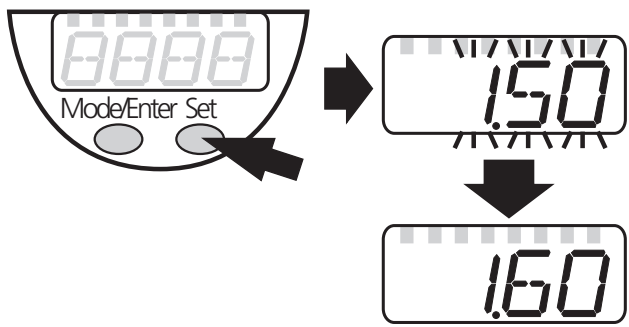1	Select parameter ▶ Press [Mode/Enter] until the requested parameter is displayed.	
2	Set parameter value ▶ Press [Set] and keep it pressed. > Current setting value of the parameter flashes for 5 s. > After 5 s: setting value is changed: incrementally by pressing once or scrolling by holding pressed.	
	Numerical values are incremented continuously. For reducing the value: let the display move to the maximum setting value. Then the cycle starts again at the minimum setting value.	
3	Acknowledge parameter value ▶ Press [Mode/Enter] briefly. > The parameter is displayed again. The new setting value is saved.	
Set other parameters ▶ Start again with step 1.		
Finish parameter setting ▶ Press [Mode/Enter] several times until the current measured value is displayed or wait for 15 s. > The unit returns to the operating mode.		

- If [SLoc] is displayed when attempting a modification of a parameter value, the sensor is locked by the software. This locking can only be removed using a parameter setting software.



- Change from menu level 1 to menu level 2:

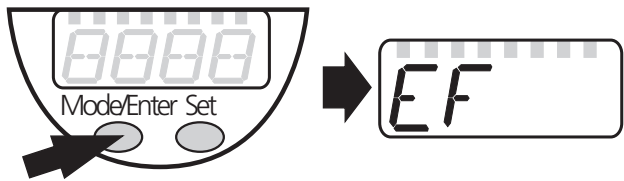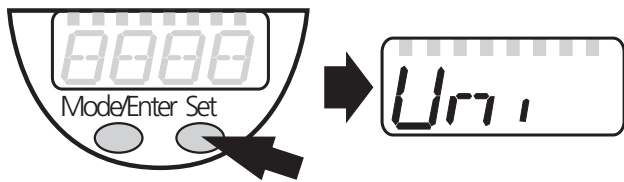- Press [Mode/Enter] until [EF] is displayed. If the submenu is protected with an access code, [Cod1] flashes in the display. - Press [Set] and keep it pressed until the valid code no. is displayed. - Press [Mode/Enter] briefly. When delivered by ifm electronic: no access restriction.	
- Press [Set] briefly. > The first parameter of the submenu is displayed (here: [Uni]).	
With the user interface of the program ifm Container: - Activate the [EF] button. If menu level 2 is protected by an access code, the input field for the code no. is activated. - Enter the valid code no.	

UK

- Locking / unlocking

The unit can be locked electronically to prevent unintentional settings.

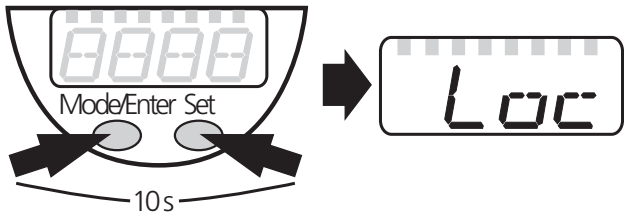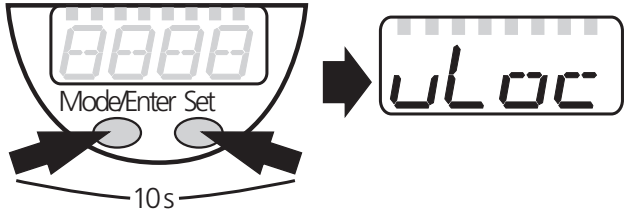- Make sure that the unit is in the normal operating mode. - Press [Mode/Enter] + [Set] for 10 s. > [Loc] is displayed.	
During operation: [LOC] is briefly displayed if you try to change parameter values.	
For unlocking: - Press [Mode/Enter] + [Set] for 10 s. > [uLoc] is displayed.	

Factory setting: not locked.

- Timeout:

If no button is pressed for 15 s during parameter setting, the unit returns to the operating mode with unchanged values.

9.2 Configure display (optional)

▶ Select [Uni] and set the unit of measurement: [bar], [mbar], [MPa], [kPa], [PSI].	Uni
▶ Select [diS] and set the update rate and orientation of the display: - [d1]: update of the measured values every 50 ms. - [d2]: update of the measured values every 200 ms. - [d3]: update of the measured values every 600 ms. - [rd1], [rd2], [rd3]: display as for d1, d2, d3; rotated by 180°. - [OFF]: display switched off in the operating mode.	d1 S

9.3 Set output signals

9.3.1 Set the output function

▶ Select [OU1] and set the function: - [Hno] = hysteresis function / normally open, - [Hnc] = hysteresis function / normally closed, - [Fno] = window function / normally open, - [Fnc] = window function/normally closed.	OU 1
▶ Select [OU2] and set the function: - [Hno] = hysteresis function / normally open, - [Hnc] = hysteresis function / normally closed, - [Fno] = window function / normally open, - [Fnc] = window function/normally closed, - [dESI] = output 2 used as a diagnostic output.	OU2

9.3.2 Set switching limits

▶ Select [SP1] / [SP2] and set the value at which the output switches.	SP 1 SP2
▶ Select [rP1] / [rP2] and set the value at which the output switches back. rPx is always smaller than SPx. The unit only accepts values which are lower than the value for SPx.	r-P 1 r-P2

9.4 User settings (optional)

9.4.1 Set delay for the switching outputs

[dS1] / [dS2] = switch-on delay for OUT1 / OUT2. [dr1] / [dr2] = switch-off delay for OUT1 / OUT2. ► Select [dS1], [dS2], [dr1] or [dr2] and set a value between 0.2 and 50 s (at 0.0 the delay time is not active).	dS 1 dS 2 dr 1 dr 2
--	---

9.4.2 Set output logic for the switching outputs

► Select [P-n] and set [PnP] or [nPn].	P--n
---	-----------------

UK

9.4.3 Set damping for the switching outputs

► Select [dAP] and set the value.

dAP value = response time between pressure change and change of the switching status in milliseconds. Damping has also an effect on the display and the IO-Link process value.

The following fixed values can be set; they define the switching frequency (f) of the output:

dAP	3	6	10	17	30	60	125	250	500
f [Hz]	170	80	50	30	16	8	4	2	1



9.5 Service functions

9.5.1 Read min/max values for the system pressure

► Select [HI] or [LO], briefly press [Set]. Select [HI] = maximum value, [LO] = minimum value. Delete memory: ► Select [HI] or [LO]. ► Press [Set] and keep it pressed until [----] is displayed. ► Press [Mode/Enter] briefly. [LO] is only available for PN014A.	HI LO
--	-----------------------------

9.5.2 Reset all parameters to factory setting

► Select [rES]. ► Press [SET] and keep it pressed until [----] is displayed. ► Press [Mode/Enter] briefly. We recommend noting down your own settings before carrying out a reset (→ 11 Factory setting).	r-ES
---	-----------------

10 Operation

After power on, the unit is in the Run mode (= normal operating mode). It carries out its measurement and evaluation functions and provides output signals according to the set parameters.



Information on the operation indications: → chapter 7 Operating and display elements.

10.1 Read set parameters

- ▶ Press [Mode/Enter] until the requested parameter is displayed.
- ▶ Press [Set] briefly.
- > The unit displays the corresponding parameter value for approx. 15 s. After another 15 s it returns to the Run mode.

10.2 Error indications

[OL]	Overload pressure (above measuring range).
[UL]	Underload pressure (below measuring range).
[SC1]	Short circuit in OUT1*.
[SC2]	Short circuit in OUT2*.
[SC]	Short circuit in both outputs*.
[Err]	Flashing: internal fault.

*The output concerned is switched off as long as the short circuit exists.


The messages SC1, SC2, SC, Err are shown even if the display is switched off.

10.3 Setting ranges

		SP1 / SP2		rP1 / rP2		ΔP
		min	max	min	max	
PN014A	bar	-0.90	10.00	-0.95	9.95	0.05
	PSI	-13	145	-14	144	1
	MPa	-0.090	1.000	-0.095	0.995	0.005
PN016A	bar	0.02	2.50	0.01	2.49	0.01
	PSI	0.4	36.2	0.2	36.0	0.2
	kPa	2	250	1	249	1

ΔP = step increment

11 Scale drawing

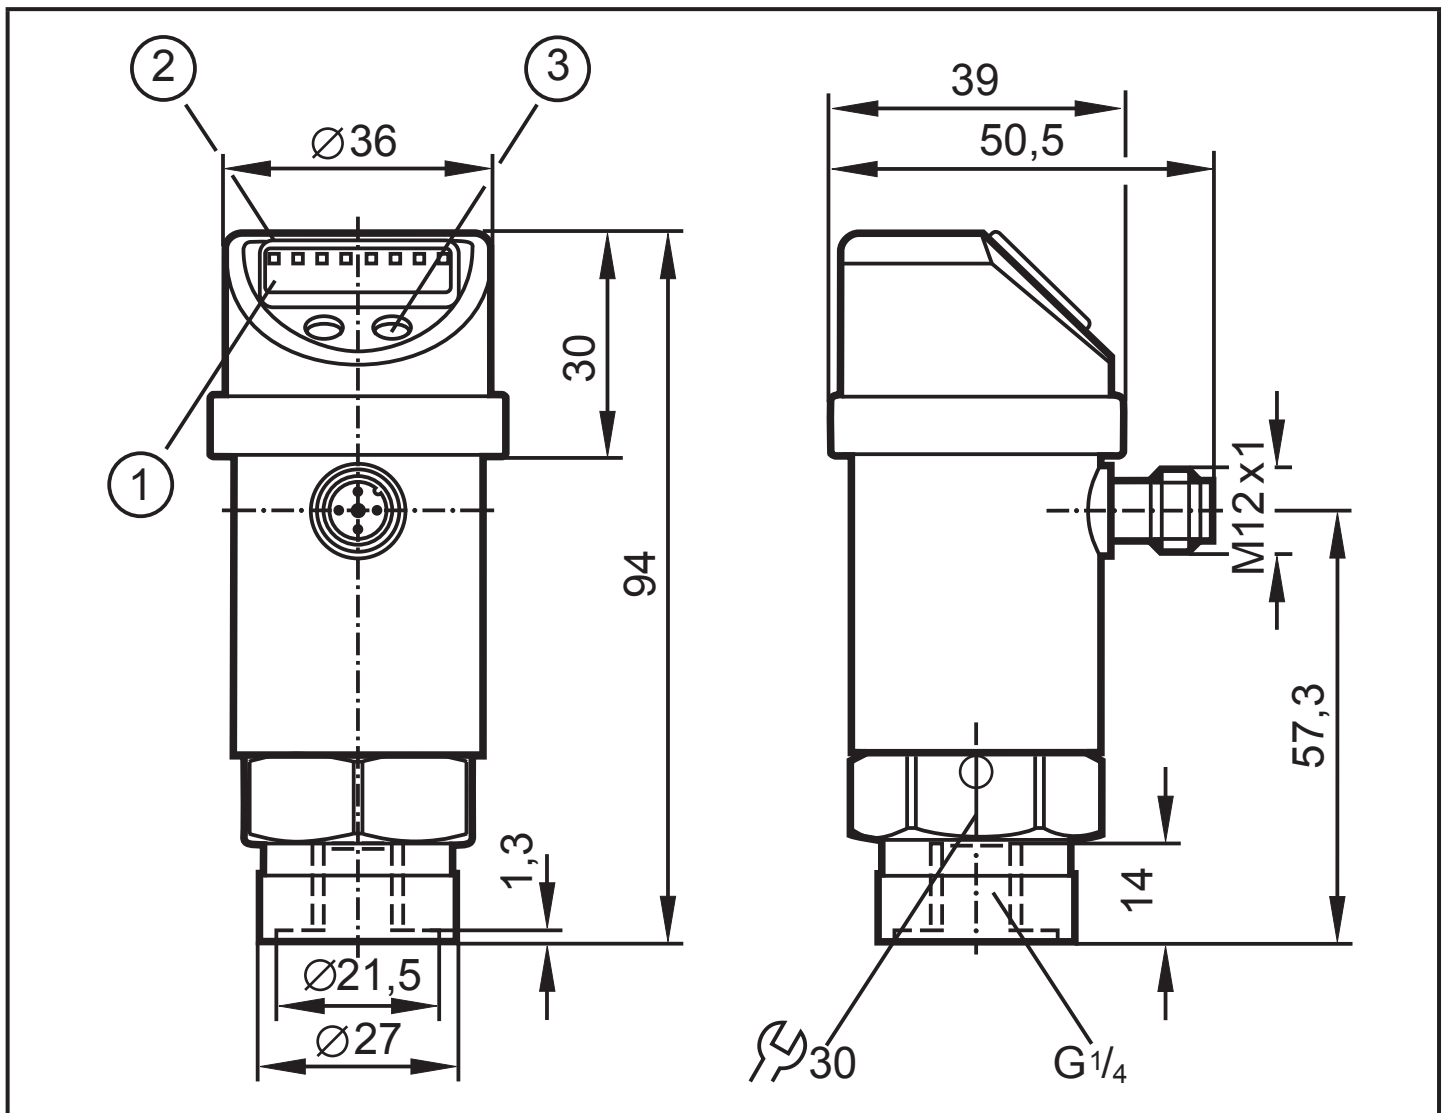

Dimensions in mm

- 1: Display
- 2: LEDs
- 3: Programming button

12 Technical data

Operating voltage [V]	18...36 DC ¹⁾
Current consumption [mA]	< 50
Current rating per switching output [mA]	250
Reverse polarity / overload protection	up to 40 V
Short-circuit protection; integrated watchdog	
Voltage drop [V]	< 2
Power-on delay time [s]	0.3
Switching frequency [Hz]	max.170

Communication interface.....	IO-Link 1.1
Baud rate [kBAUD]	38.4
Accuracy / deviations (in % of the span)	
- Switch point accuracy	< ± 0.5
- Linearity error	< ± 0.25 (BFSL) / < ± 0.5 (LS)
- Hysteresis	< 0.25
- Repeatability (in case of temperature fluctuations < 10 K)	< ± 0.1
- Long-term stability (in % of the span per 6 months)	< ± 0.05
- Temperature coefficients (TEMPCO) in the compensated Temperature range 0 ... 60 °C (in % of the span per 10 K)	
Greatest TEMPCO of the zero point / span	< ± 0.2 / < ± 0.2
Material (wetted parts).....	stainless steel (303/1.4305); ceramics; FPM (Viton)
Housing material.....	stainless steel (304/1.4301) high-grade stainless steel (316L/1.4404) PC (Makrolon); PBT (Pocan), PEI; FPM (Viton)
Protection rating	IP 65, III
Shock resistance [g]	50 (DIN / IEC 68-2-27, 11 ms)
Vibration resistance [g]	20 (DIN / IEC 68-2-6, 10 - 2000 Hz)
Switching cycles min.	100 million
Ambient temperature [°C]	-20...60
Medium temperature [°C]	-20...60
Storage temperature [°C]	-40...100
EMC EN 61000-4-2 ESD:	4 / 8 kV
EN 61000-4-3 HF radiated:	10 V/m
EN 61000-4-4 Burst:	2 kV
EN 61000-4-5 Surge:	0.5 / 1 kV
EN 61000-4-6 HF conducted:	10 V

¹⁾ to EN 50178, SELV, PELV

BFSL = Best Fit Straight Line / LS = Limit value Setting

13 Factory setting

	Factory setting	User setting
SP1	25 % VMR*	
rP1	23 % VMR*	
OU1	Hno	
OU2	Hno	
SP2	75 % VMR*	
rP2	73 % VMR*	
dS1	0.0	
dr1	0.0	
dS2	0.0	
dr2	0.0	
P-n	PnP	
dAP	60	
diS	d2	
Uni	bAr / mbAr	

* = the indicated percentage of the final value of the measuring range (VMR) of the respective sensor (for PN014 the percentage of the measuring span) is set in bar / mbar.

Technical data and further information at
www.ifm.com → Select your country → Data sheet search